



Smith-Blair
a xylem brand

Installation Instructions

622

Tapping Sleeve

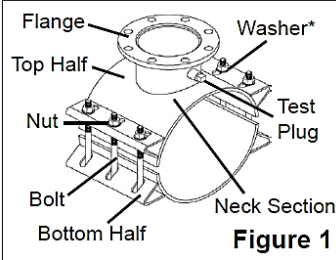


Figure 1

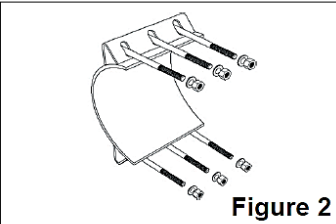


Figure 2

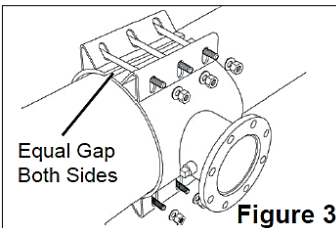


Figure 3

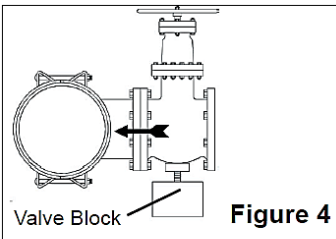


Figure 4

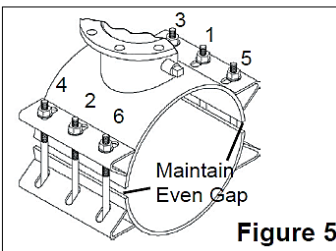


Figure 5

STEP 1

Inspect the shipment received to ensure no damage has occurred during transit or storage and no hardware is missing. Ensure the tapping sleeve is the proper type, tap size, and correct pipe size range for the installation prior to beginning.

STEP 2

Clean the pipe surface thoroughly, particularly in the area where the gasket will seat. Remove any scale, dirt, or debris that could affect the gasket seal.

STEP 3

Check the pipe outside diameter where the tapping sleeve will be installed to ensure that the correct tapping sleeve is being used.

NOTE: Pipe must be round in the area where sleeve will be installed (See Roundness Table)

STEP 4

Remove the nuts, washers, and bolts, then the bottom half of the tapping sleeve (See Figure 2).

STEP 5

Verify that the gasket is secure in the gasket groove (See Gasket Detail), then lubricate the pipe and gasket with a non-detergent soap solution. Ensure the lubricant does not freeze.



Gasket Detail

STEP 6

Mount the sleeve halves on the pipe with the test outlet accessible and the flanged portion of the sleeve facing the connecting pipe. To prevent gasket failure, do not slide or rotate the tapping sleeve while mounted on the pipe.

STEP 7

Install the bolts and washers, then hand tighten the nuts with equal gaps between the sleeve halves (See Figure 3). *Stainless bolts, washers, and nuts will be supplied with a nylon washer which is used between the nut and washer.

STEP 8

Tighten the nuts starting from the center outward, alternating from side to side, to maintain uniform spacing between the sleeve halves (See Figure 5). Continue to tighten the nuts until the sleeve halves form to the contour of the pipe, and all nuts are tightened to the specified torque (See "Bolt Torque" Table).

STEP 9

Proper blocking of the valve and/or tapping equipment is required. Improper blocking will cause the sleeve to pull away from the pipe and proper torque will not be achieved (See Figure 4). On some installations, the valve and/or tapping machine may be installed on the sleeve prior to hoisting into the trench.

STEP 10

Following the manufacturer's instructions, install the tapping valve while providing thrust blocking and a permanent support beneath the valve.

NOTE: Smith-Blair recommends using 1/8" thick, ring style elastomeric valve flange gaskets. For mechanical joint (MJ) outlets use only gaskets, hardware, and installation procedure per AWWA C111.

STEP 11

Hydrostatic pressure test the tapping sleeve, flange gasket, and tapping valve to ensure all joints are tight and that gaskets are properly seated.

Do Not Air Test! Use Hydrostatic Test Only! Pressure test should not exceed 1.5 times actual line pressure.

For pipe diameters larger than 36": pressure test to 50 - 75 psi; release pressure; re-torque all nuts; pressure test to full pressure.

STEP 12

Using the tapping machine's manufacturer instructions, install the tapping machine to the valve and perform the tap.

NOTE: A 1/2" under size cutter is required for size-on-size applications. Confirm proper clearance between the cutter and neck/outlet inside diameter.

STEP 13

Re-torque all nuts to the specified torque. If possible, nuts should be checked 12-24 hours after installation.

ROUNDNESS	
Pipe Size	Tolerance
4" thru 24"	± .06"
30" thru 48"	± .12"
above 48"	± .19"

BOLT TORQUE	
Size	Torque
5/8"	50-60 ft-lbs
3/4"	90-100 ft-lbs
1"	100-120 ft-lbs

USE OF A CALIBRATED TORQUE WRENCH IS RECOMMENDED!




Smith-Blair
a xylem brand

Installation Instructions


622 Tapping Sleeve




DO NOT USE COMPRESSED AIR OR GAS TO PRESSURE TEST THIS PRODUCT. Testing with compressed air or gas can result in violent pipe content escape resulting in property damage, serious injury, or death. Only a hydrostatic (water) pressure test should be used to test the integrity of the product(s) seal(s). Read the product installation instructions prior to installing this product.



THIS PRODUCT REQUIRES UNIFORM TORQUE TO PROVIDE AN EFFECTIVE SEAL AGAINST THE PIPE SURFACE. Gap distances between product halves must remain equal while product is installed. The product must be evenly tightened across the sleeve to the required torque. The product will not function properly if the nuts on only the top or bottom side of the tapping sleeve are tightened. Failure to uniformly torque the product may cause damage to the pipe, sleeve, or result in product failure.



THIS PRODUCT IS NOT DESIGNED TO PROVIDE STRUCTURAL RIGIDITY FOR CONNECTIONS, EQUIPMENT, OR ANY ALTERNATE USE OF THE PRODUCT. Permanently blocking and/or support for connections, equipment, or any alternate use of the product must be provided. Failure to do so may cause damage to the pipe, sleeve, or result in product failure.



SLEEVE NECK/OUTLET INNER DIAMETER AND TAPPING MACHINE'S CUTTING DIAMETER MAY DIFFER. Ensure proper clearance between cutter outside diameter and neck/outlet inside diameter by measuring. A 1/2" undersized cutter may be required for size-on-size tapping applications. Failure to do so may cause damage to the pipe, sleeve, and/or tapping machine resulting in product failure.

WARRANTY

Smith-Blair, Inc. warrants its products to be free of defects in materials and workmanship for a period of one (1) year from the date of shipment by Smith-Blair, Inc. (the "Warranty Period"). Dated proof of purchase, such as a bill of sale, is required to establish warranty eligibility. If a product fails to perform due to a defect in materials or workmanship during the Warranty Period, Smith-Blair, Inc. will repair or, at Smith Blair, Inc.'s option, replace the product with the same or comparable item. In the event that the product cannot be repaired and a suitable replacement item is not available, Smith-Blair, Inc. will refund the original purchase price shown on the proof of purchase. In all cases, the customer is responsible for returning the allegedly defective product to the factory or warehouse designated by Smith-Blair, Inc.

THIS LIMITED WARRANTY IS EXCLUSIVE AND IS IN LIEU OF ANY EXPRESS OR IMPLIED WARRANTY OF MERCHANTABILITY, FITNESS FOR A PARTICULAR PURPOSE, OR OTHER WARRANTY OF QUALITY, OR THOSE ARISING FROM A COURSE OF DEALING, CUSTOM, OR USAGE OF TRADE. THE REMEDIES PROVIDED IN THIS LIMITED WARRANTY STATEMENT ARE THE CUSTOMER'S SOLE AND EXCLUSIVE REMEDIES. IN NO EVENT SHALL SMITH-BLAIR, INC. BE LIABLE FOR DIRECT, INDIRECT, SPECIAL, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, WHETHER BASED ON CONTRACT, TORT, OR ANY OTHER LEGAL THEORY, AND WHETHER ADVISED OF THE POSSIBILITY OF SUCH DAMAGES.

04/18

CORROSION & PRODUCT SELECTION NOTICE

Metal products are subject to corrosion, particularly when used outdoors and/or underground. A large number of factors and local conditions affect the rate of corrosion. Consult a local corrosion expert to determine the life expectancy of this product when used with your pipeline content, soil, and environment. Also, consult your system designer to determine the suitability of this product in your piping system. Failure to determine the suitability of this product in your application, soil, and/or environment can result in premature product failure. Smith-Blair will provide additional information about this product's material specifications at your request. You may also obtain product information at www.smith-blair.com.

04/18